





**2013
CA ELECTRICAL CODE
680.6, 680.22(A),
680.32, 680.34,
680.43(A), 680.62(E)**

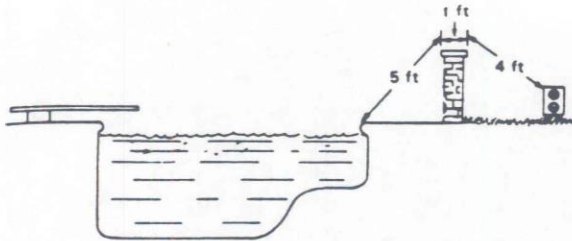


This figure illustrates the shortest path a supply cord of an appliance connected to the receptacle would follow without piercing the wall.

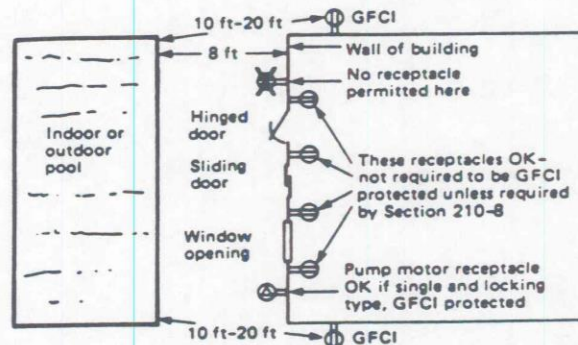

Acceptable receptacle locations within 20 feet of a swimming pool

In determining the above dimensions the distance to be measured is the shortest path the supply cord of an appliance connected to the receptacle would follow without piercing a floor, wall, ceiling, doorway with hinged or sliding door, window opening or other effective permanent barrier.

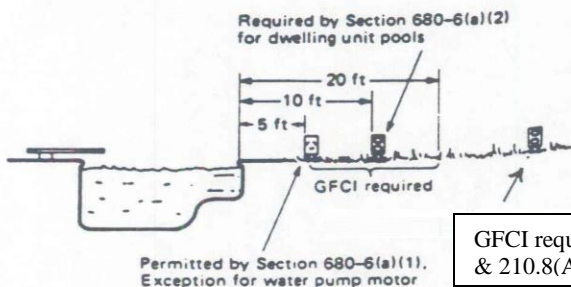

GFCI required as per Section 210-8(B)(5) & 210.8(A)(3)